


SCHWINGGESCHWINDIGKEIT



DATEI: 2492-PG14-09062026-074254_raw.csv	
Aufzeichnungsdauer: 11.22 s Abtastrate: 1000 Hz	
Datum:	09.06.2026
Zeit:	07:42:54
Event-ID:	2492-PG14-09062026-074254
Kalibrier Datum:	12.07.2025
Spitzwerte	
V-x (Longitudinal)	V-y (Transversal)
1.88 mm/s	0.61 mm/s
27.3 Hz	34.6 Hz
20.20% von Limit	5.48% von Limit
V-z (Vertikal)	
2.38 mm/s	
69.9 Hz	
14.00% von Limit	
V-n (Vektorsumme): 2.62 mm/s	

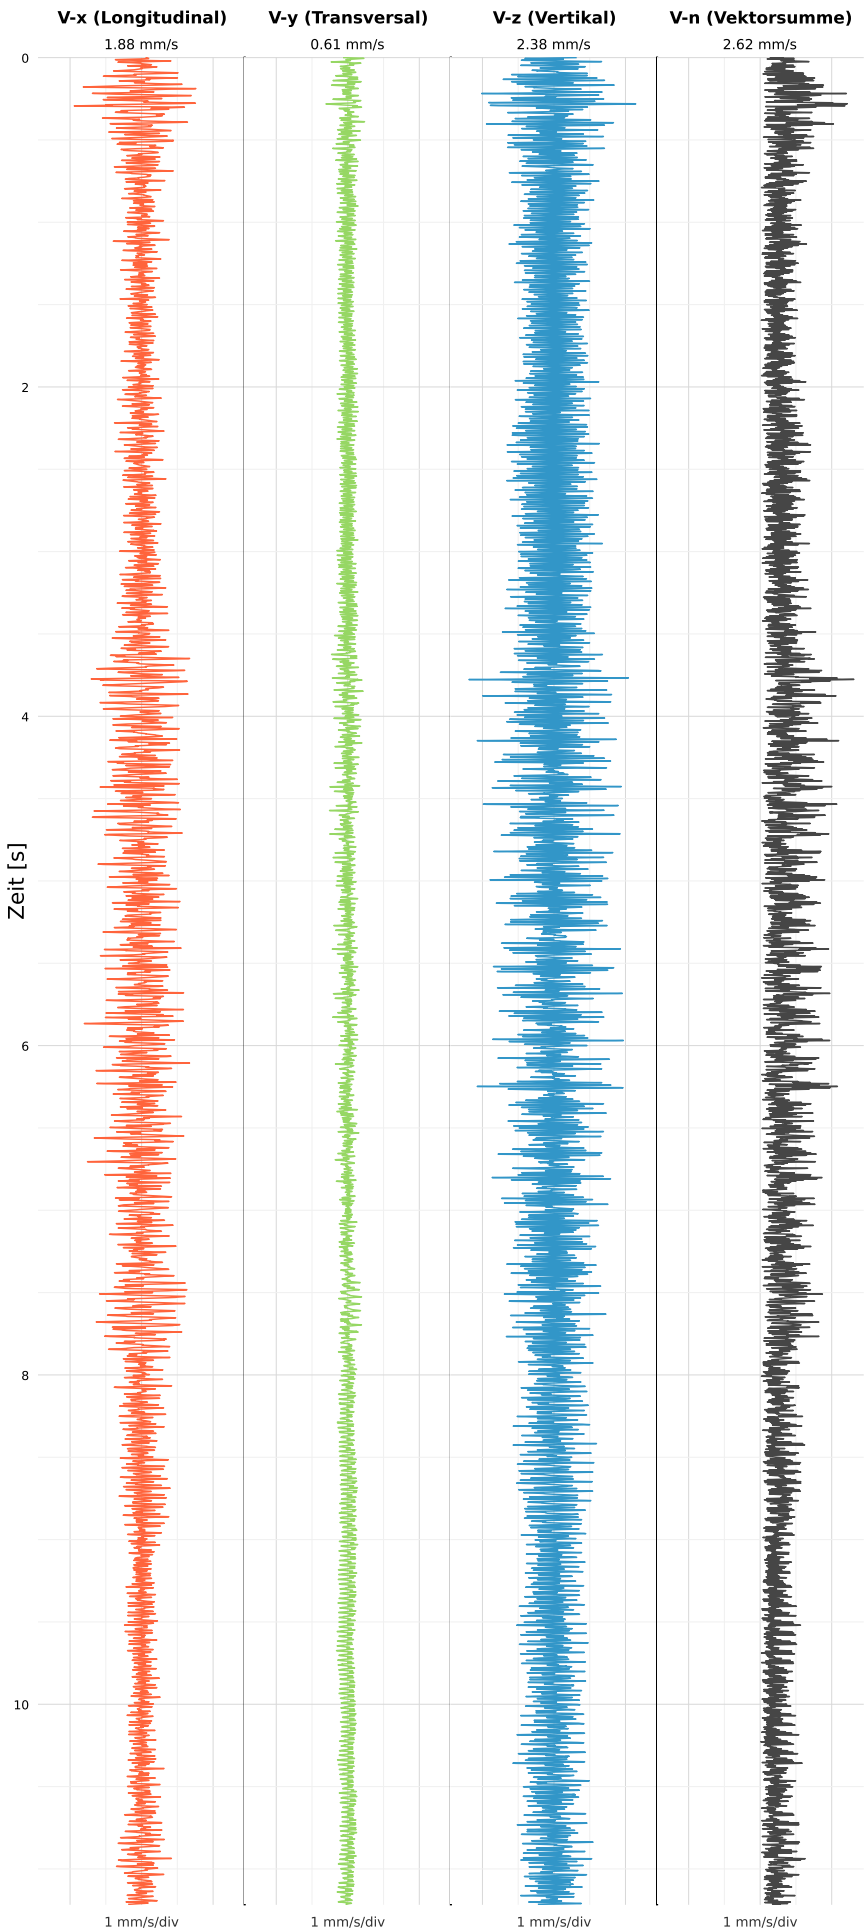